

ATTENZIONE

dispositivo sensibile all'elettrostaticità maneggiare con cura

WARNING

Observe precaution when handling. Electrostatic sensitive device

ATTENTION

Faites attention lors de la maintenance, le dispositif est sensible aux perturbations électrostatiques

ATENCIÓN

Tenga precaución durante el manejo. Aparato sensible a campos electrostáticos.

UWAGA

Podczas montażu zachować ostrożność. Urządzenie wrażliwe elektrostatycznie

ВНИМАНИЕ!

Соблюдайте предосторожность при монтаже прибора. Устройство чувствительно к статическому электричеству.

DİKKAT










Kullanırken önlem alın. Elektrostatığe duyarlı ürün.




WAARSCHUWING

Voorzichtig bij het hanteren. Elektrostatisch gevoelig apparaat.

FIGYELEM

Óvatosan bánjon vele kezelésekor. Elektrosztatikusságra érzékeny berendezés.

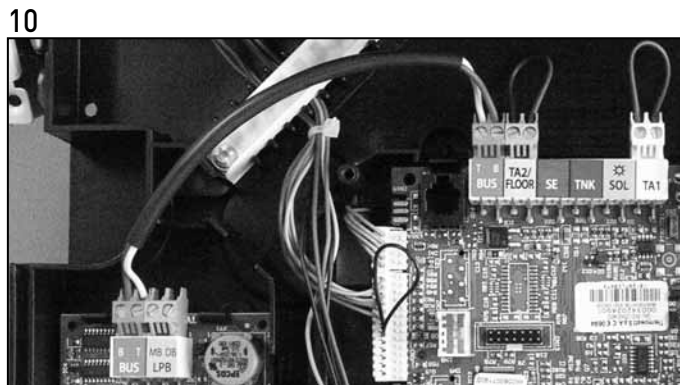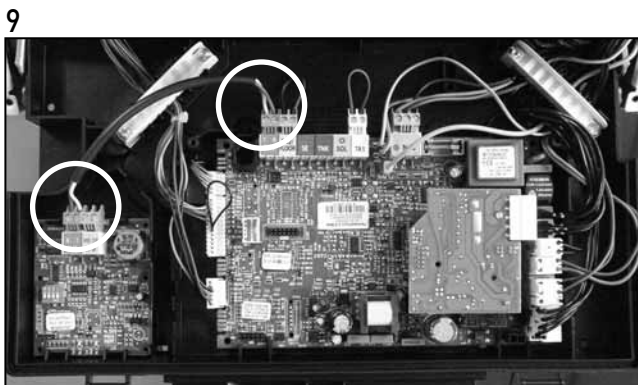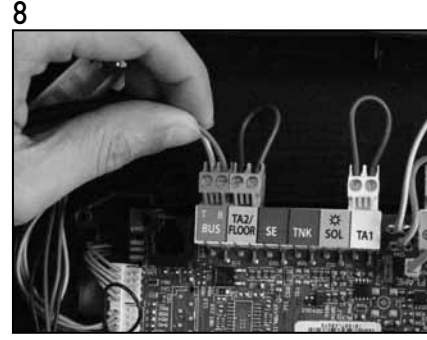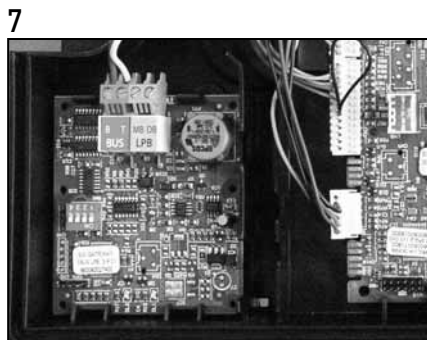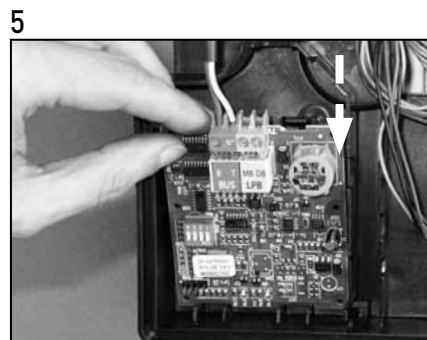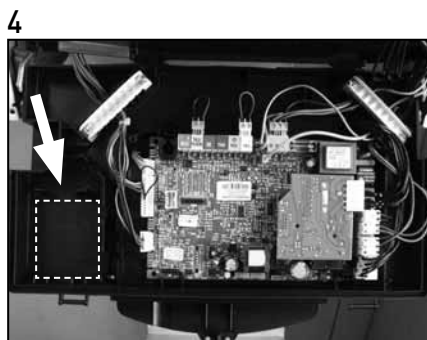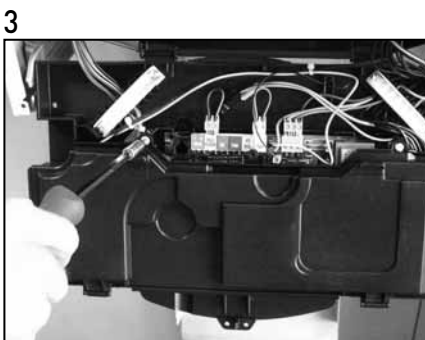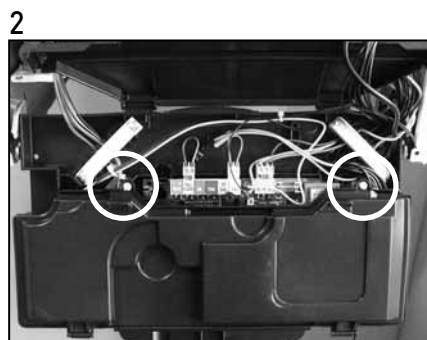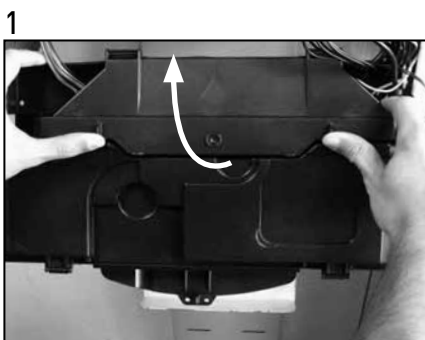

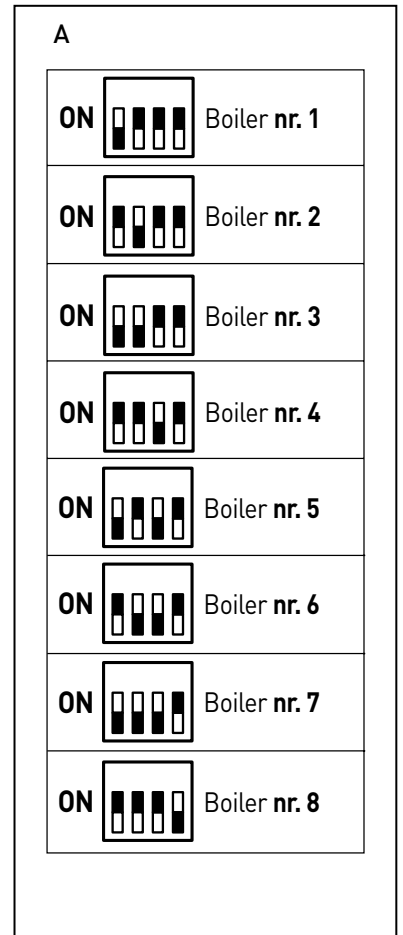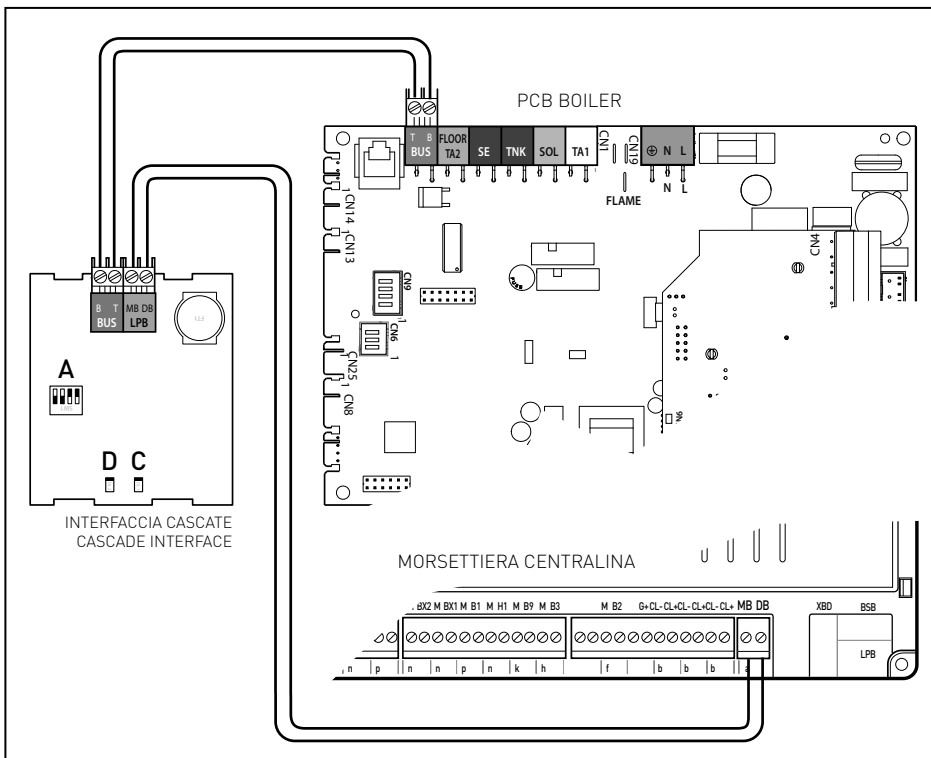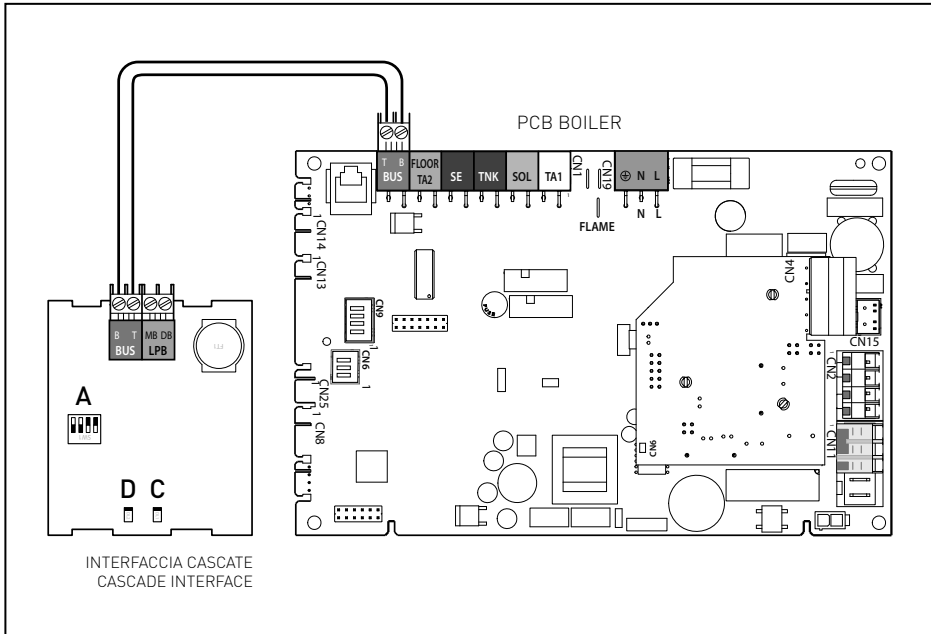

LED		PROBLEMA
C + D	Spento	Interfaccia cascate non connessa
C	Acceso	Interfaccia cascate alimentata
D	Lampeggiante	Comunicazione LPB presente
D	Spento	Comunicazione LPB assente

LED		FAULT
C + D	OFF	Cascade interface not connected
C	ON	Cascade interface powered
D	Blinking	LPB communication present
D	OFF	LPB communication not present

LED		DÉFAUT
C + D	OFF	Interface cascade non connectée
C	ON	Interface cascade alimentée
D	Clignote	Communication LPB présente
D	OFF	Communication LPB absente

LED		DEFECTO
C + D	OFF	Interfaz de cascada no conectado
C	ON	Interfaz de cascada alimentado
D	Parpadeando	Dispositivo LPB con conexión establecida
D	OFF	Dispositivo LPB sin conexión

LED		BŁĄD
C + D	OFF	Interfejs kaskady nie podłączony
C	ON	Interfejs kaskady zasilany
D	Miga	Komunikacja aktywna
D	OFF	Komunikacja nieaktywna

Индикатор		НЕИСПРАВНОСТЬ
C + D	Не горит	Каскадный интерфейс не подключен
C	Горит	Каскадный интерфейс подключен
D	Мигает	Отсутствует связь с модулем LPB
D	Не горит	LPB-модуль не обнаружен или не подключен

LED		ARIZA
C + D	Kapalı	Kaskad arayüzü bağlı değil
C	Açık	Kaskad arayüzü bağlı
D	Yanıp sönüyor	LPB iletişimi var
D	Kapalı	LPB iletişimi yok

LED		FOUT
C + D	OFF	Cascade-interface niet aangesloten
C	ON	Cascade-interface aangesloten
D	Knipperend	LPB communicatie aanwezig
D	OFF	LPB geen communicatie

LED		HIBA
C + D	KI	kaskád interface nem csatlakozik
C	BE	kaskád interface mĕködik
D	VILLOG	LPB kommunikáció jelen van
D	KI	LPB kommunikáció nincs jelen

LED		F!!
C + D	OFF	Cascade interface not connected
C	ON	Cascade interface powered
D	Blinking	LPB communication present
D	OFF	LPB communication not present

